

DWG	SHEET TITLE	SPECIAL REQUIREMENTS AND NOTES
300.01	METHOD OF PIPE INSTALLATION – METHOD A	
310.02	PARALLEL PIPE END SECTION—PRECAST CONCRETE FOR 15" TO 24" PIPE	REQUIRED IN RIGHT OF WAY WITHIN THE ETJ
310.03	CROSS PIPE END SECTION—PRECAST CONCRETE FOR 18" TO 30" PIPE	REQUIRED IN RIGHT OF WAY WITHIN THE ETJ
310.10	DRIVEWAY PIPE CONSTRUCTION USING NO SPECIAL END SECTIONS	ONLY AT LOCATIONS APPROVED BY THE TOWN ENGINEER
815.03	PIPE UNDERDRAIN AND BLIND DRAIN	
816.03	GEOCOMPOSITE SHOULDER DRAIN	
838.01	CONCRETE ENDWALL FOR SINGLE AND DOUBLE PIPE CULVERTS	NOTE 1
	15" THRU 48" PIPE 90° SKEW	NOTE 1
838.02	CONCRETE ENDWALL AND SLUICE GATE 15" THRU 36" PIPE—90° SKEW	NOTE 1
838.04	CONCRETE ENDWALL FOR SINGLE AND DOUBLE PIPE CULVERTS	NOTE 1
	17"x13" THRU 71"x47" PIPE ARCH 90° SKEW	NOTE 1
838.05	CONCRETE "L" ENDWALL FOR SINGLE PIPE CULVERTS 15" THRU 48" PIPE	NOTE 1
838.06	CONCRETE "L" ENDWALL FOR SINGLE PIPE CULVERTS 17"x13" THRU 71"x47"	NOTE 1
	71"x47" ARCH PIPE	NOTE 1
838.07	CONCRETE ENDWALL FOR SINGLE AND DOUBLE PIPE CULVERTS	NOTE 1
	40"x31" THRU 66"x51" PIPE ARCH 90° SKEW	NOTE 1
838.08	CONCRETE "L" ENDWALL FOR SINGLE PIPE CULVERTS 40"x32"	NOTE 1
	THRU 66"x51" PIPE ARCH	NOTE 1
838.10	CONCRETE ENDWALL FOR OUTFALL 4', 6" OR 8" PIPE	NOTE 1
838.11	BRICK ENDWALL FOR SINGLE AND DOUBLE PIPE CULVERTS	NOTE 1
	15" THRU 48" 90° SKEW	NOTE 1
838.14	BRICK ENDWALL FOR SINGLE AND DOUBLE PIPE CULVERTS 17"x31"	NOTE 1
	THRU 71"x47" 90° SKEW	NOTE 1
838.15	BRICK "L" ENDWALL FOR SINGLE PIPE CULVERTS 15" THRU 48" PIPE	NOTE 1
838.16	BRICK "L" ENDWALL FOR SINGLE PIPE CULVERTS 17"x13" THRU	NOTE 1
	71"x47" PIPE ARCH	NOTE 1
838.17	BRICK ENDWALL FOR SINGLE AND DOUBLE PIPE CULVERTS 40"x31"	NOTE 1
	THRU 66"x51" PIPE ARCH 90° SKEW	NOTE 1
838.18	BRICK ENDWALL FOR SINGLE PIPE CULVERTS 40"x31" THRU	NOTE 1
	66"x51" PIPE ARCH	NOTE 1
838.20	BRICK ENDWALL FOR OUTFALL 4", 6" AND 8" PIPE	NOTE 1
838.21	REINFORCED CONCRETE ENDWALL FOR SINGLE 54" PIPE 90° SKEW	NOTE 1 SEE PLDS 20.17 A&B FOR SPLASH PAD
838.22	REINFORCED CONCRETE ENDWALL FOR DOUBLE & TRIPLE 54" PIPE 90° SKEW	NOTE 1 SEE PLDS 20.17 A&B FOR SPLASH PAD
838.27	REINFORCED CONCRETE ENDWALL FOR SINGLE 60" PIPE 90° SKEW	NOTE 1 SEE PLDS 20.17 A&B FOR SPLASH PAD
838.28	REINFORCED CONCRETE ENDWALL FOR DOUBLE & TRIPLE 60" PIPE 90° SKEW	NOTE 1 SEE PLDS 20.17 A&B FOR SPLASH PAD
838.33	REINFORCED CONCRETE ENDWALL FOR SINGLE 66" PIPE 90° SKEW	NOTE 1 SEE PLDS 20.17 A&B FOR SPLASH PAD
838.34	REINFORCED CONCRETE ENDWALL FOR DOUBLE & TRIPLE 66" PIPE 90° SKEW	NOTE 1 SEE PLDS 20.17 A&B FOR SPLASH PAD
838.39	REINFORCED CONCRETE ENDWALL FOR SINGLE 72" PIPE 90° SKEW	NOTE 1 SEE PLDS 20.17 A&B FOR SPLASH PAD
838.40	REINFORCED CONCRETE ENDWALL FOR DOUBLE & TRIPLE 72" PIPE 90° SKEW	NOTE 1 SEE PLDS 20.17 A&B FOR SPLASH PAD

NOTE 1: FOR ALL STRUCTURES – NCDOT REQUIRES CLASS B CONCRETE (2500 PSI). THE TOWN REQUIRES 3600 PSI CONCRETE STRENGTH @ 28 DAYS. 3600 PSI CONCRETE SHALL BE USED IN ALL TOWN PROJECTS.

NOT TO SCALE



**TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS**

**NCDOT STANDARDS
APPROVED FOR USE IN THE TOWN OF PINEVILLE**

8/1/19

STD. NO.	REV.
20.00A	3

DWG	SHEET TITLE	SPECIAL REQUIREMENTS AND NOTES
838.45	NOTES FOR REINFORCED CONCRETE ENDWALL STANDARD DRAWINGS	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
	838.21 THRU 838.40	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.51	REINFORCED BRICK ENDWALL FOR SINGLE 54" PIPE 90° SKEW	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.52	REINFORCED BRICK ENDWALL FOR DOUBLE & TRIPLE 54" PIPES 90° SKEW	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.57	REINFORCED BRICK ENDWALL FOR SINGLE 60" PIPE 90° SKEW	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.58	REINFORCED BRICK ENDWALL FOR DOUBLE & TRIPLE 60" PIPES 90° SKEW	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.63	REINFORCED BRICK ENDWALL FOR SINGLE 66" PIPE 90° SKEW	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.64	REINFORCED BRICK ENDWALL FOR DOUBLE & TRIPLE 66" PIPES 90° SKEW	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.69	REINFORCED BRICK ENDWALL FOR SINGLE 72" PIPE 90° SKEW	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.70	REINFORCED BRICK ENDWALL FOR DOUBLE & TRIPLE 72" PIPES 90° SKEW	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.75	NOTES FOR REINFORCED BRICK ENDWALL STANDARD DRAWINGS 838.51 THRU 838.70	NOTE 1 SEE STD 20.17 A&B FOR SPLASH PAD
838.80	PRECAST CONCRETE ENDWALL FOR SINGLE 12" THRU 72" PIPE 90° SKEW	
840.00	CONCRETE BASE PAD FOR DRAINAGE STRUCTURES	
840.01	BRICK CATCH BASIN 15" THRU 54" PIPE	
840.02	CONCRETE CATCH BASIN 12" THRU 54" PIPE	
840.03	FRAME, GRATES, AND HOOD FOR USE ON STANDARD CATCH BASIN	
840.04	CONCRETE OPEN THROAT CATCH BASIN 12" THRU 48" PIPE	NOTE 1; OPENINGS PERMITTED IN 4 SIDES OUTSIDE OF STREET R/W MANHOLE RING AND COVER REQUIRED IN TOP SLAB SEE PLDS 20.05 A&B
840.05	BRICK OPEN THROAT CATCH BASIN 15" THRU 48" PIPE	NOTE 1; OPENINGS PERMITTED IN 4 SIDES OUTSIDE OF STREET R/W MANHOLE RING AND COVER REQUIRED IN TOP SLAB SEE PLDS 20.05 A&B
840.14	CONCRETE DROP INLET 12" THRU 30" PIPE	NOTE 1
840.15	BRICK DROP INLET 12" THRU 30" PIPE	NOTE 1
840.16	DROP INLET FRAME AND GRATE FOR USE WITH STANDARD DRAWINGS 840.14 & 840.15	NOTE 1
840.17	CONCRETE GRATED DROP INLET TYPE "A" 12" THRU 72" PIPE	NOTE 1
840.18	CONCRETE GRATED DROP INLET TYPE "B" 12" THRU 36" PIPE	NOTE 1
840.19	CONCRETE GRATED DROP INLET TYPE "D" 12" THRU 36" PIPE	NOTE 1
840.20	FRAMES AND WIDE SLOT FLAT GRATES	NOT FOR USE IN PEDESTRIAN AREAS
840.22	FRAMES AND WIDE SLOT SAG GRATES	NOT FOR USE IN PEDESTRIAN AREAS
840.24	FRAMES AND NARROW SLOT SAG GRATES	
840.25	ANCHORAGE FOR FRAMES BRICK OR CONCRETE	
840.26	BRICK GRATED DROP INLET TYPE "A" 12" THRU 72" PIPE	
840.27	BRICK GRATED DROP INLET TYPE "B" 12" THRU 36" PIPE	
840.28	BRICK GRATED DROP INLET TYPE "D" 12" THRU 36" PIPE	
840.29	FRAMES AND NARROW SLOT FLAT GRATES	
840.30	DRIVEWAY DROP INLET	

NOTE 1: FOR ALL STRUCTURES – NCDOT REQUIRES CLASS B CONCRETE (2500 PSI). THE TOWN REQUIRES 3600 PSI CONCRETE STRENGTH @ 28 DAYS. 3600 PSI CONCRETE SHALL BE USED IN ALL TOWN PROJECTS.

NOT TO SCALE



**TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS**


**NCDOT STANDARDS
APPROVED FOR USE IN THE TOWN OF PINEVILLE**

8/1/19


STD. NO.	REV.
20.00B	3

GENERAL NOTES:


1. SEE NCDOT STANDARD 840.01 FOR DETAILS BASED ON PIPE SIZE PER CROSS SECTION.
2. CONSTRUCT TWO SINGLE BASINS PER NCDOT STANDARD WITH DOUBLE INTERIOR WALL.
3. ALL CONCRETE TO BE 3600 P.S.I COMPRESSIVE STRENGTH.
4. BASE SLAB SHALL BE MONOLITHIC.
5. SEE PLDS #10.29 AND #10.30 FOR PLACEMENT OF CATCH BASIN.
6. PIPE SECTION D2 CONNECTING CATCH BASINS SHALL HAVE A MINIMUM DIAMETER SAME AS OF OUTLET PIPE D3.
7. ALL REINFORCING STEEL SHOWN ON NCDOT STANDARDS IS TO BE PROVIDED AS CONTINUOUS MEMBERS. (NO LAPS, USED AS A SINGLE CONTINUOUS BAR IN THE SLAB)
8. WEEP HOLES SHALL BE PLACED IN BACK WALL WITH FILTER FABRIC OR STONE ON BACK SIDE

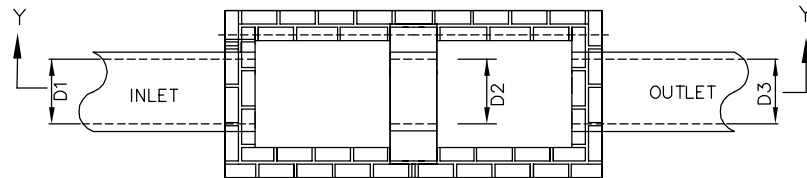


PLAN

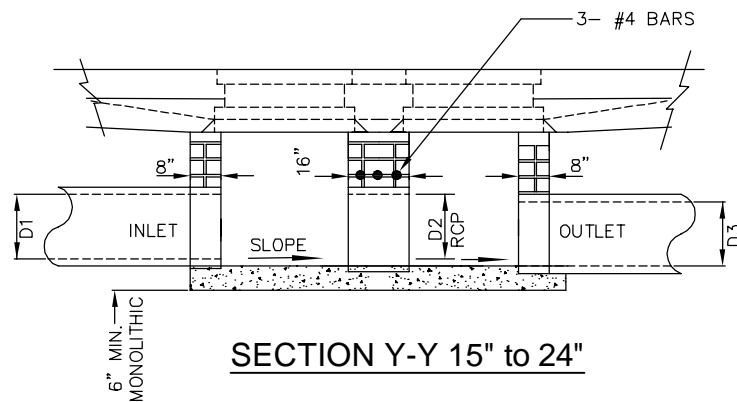

SECTION Y-Y 15" to 24"

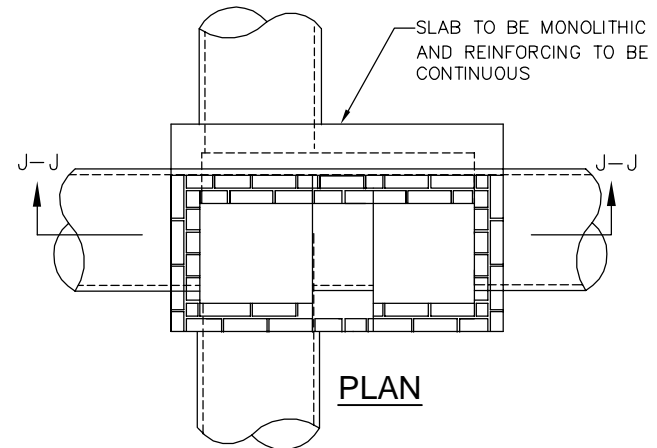

PLAN

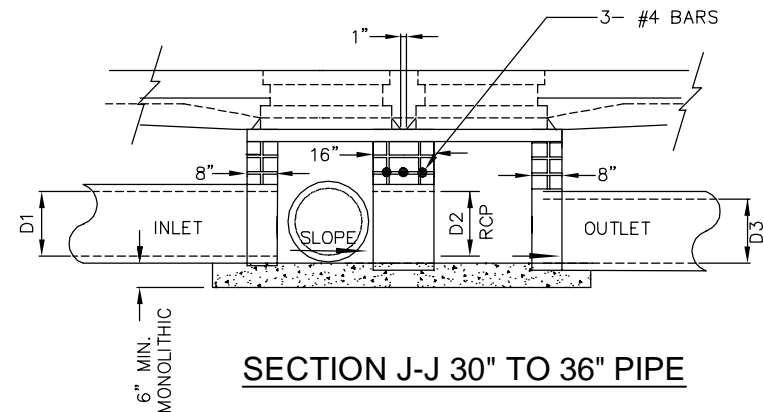

SECTION J-J 30" TO 36" PIPE

NOT TO SCALE



TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS


BRICK DOUBLE CATCH BASIN
15" THRU 36" PIPE

STD. NO.	REV.
20.03	


GENERAL NOTES:

1. MORTAR JOINTS SHOULD BE BETWEEN 3/8" AND 5/8" THICK.
2. ALL CONCRETE TO BE 3600 P.S.I COMPRESSIVE STRENGTH.
3. THE 6" OPENING SHOWN MAY BE INCREASED TO 8" MAX. IF DEEMED TO BE NECESSARY BY THE ENGINEER.
4. ALL CATCH BASIN OVER 3'-6" IN DEPTH SHALL BE PROVIDED WITH STEPS 1'-2" ON CENTERS. STEPS SHALL BE IN ACCORDANCE WITH NCDOT STD. 840.60.
5. CONCRETE BRICK MAY BE USED IN LIEU OF HARD COMMON CLAY BRICK.
6. JUMBO BRICK WILL BE PERMITTED.
7. FOR 8'-0" IN HEIGHT OR LESS USE 8" WALL. OVER 8'-0" IN HEIGHT USE 12" WALL TO 6'-0" FROM TOP OF WALL, AND 8" WALL FOR THE REMAINING 6'-0".
8. ALL EXPOSED JOINTS WILL BE CONCAVE TOOLED.
9. ALL PIPE IN STORM DRAIN STRUCTURE SHALL BE STRUCK EVEN WITH THE INSIDE WALL, GROUTED AND BRUSHED SMOOTH.
10. WEEP HOLES SHALL BE PLACED IN BACK WALL WITH FILTER FABRIC OR STONE ON BACK SIDE.
11. THIS CATCH BASIN IS NOT TO BE USED WITHIN STREET RIGHT OF WAY UNLESS OTHERWISE APPROVED BY TOWN ENGINEER.


DIMENSIONS OF BOX AND PIPE				REINFORCING					COVER DIMENSION	
PIPE	SPAN	WIDTH	HEIGHT	BARS - X		BARS - Y		TOTAL	F	G
D	A	B	H1 (MIN.)	NO.	LENGTH	NO.	LENGTH	LBS.		
15"	3'-6"	2'-3"	2'-7"	2	3'-4"	7	4'-7"	26	4'-10"	3'-7"
18"	4'-0"	2'-8"	2'-11"	2	3'-9"	8	5'-1"	33	5'-4"	4'-0"
24"	4'-0"	2'-8"	3'-5"	2	3'-9"	8	5'-1"	33	5'-4"	4'-0"
30"	4'-0"	3'-6"	3'-11"	2	4'-7"	9	5'-1"	37	5'-4"	4'-10"
36"	4'-0"	3'-6"	4'-6"	2	4'-7"	9	5'-1"	37	5'-4"	4'-10"
42"	4'-0"	3'-6"	4'-11"	2	4'-7"	9	5'-1"	37	5'-4"	4'-10"
48"	4'-6"	4'-0"	5'-5"	2	5'-1"	10	5'-7"	45	5'-10"	5'-4"

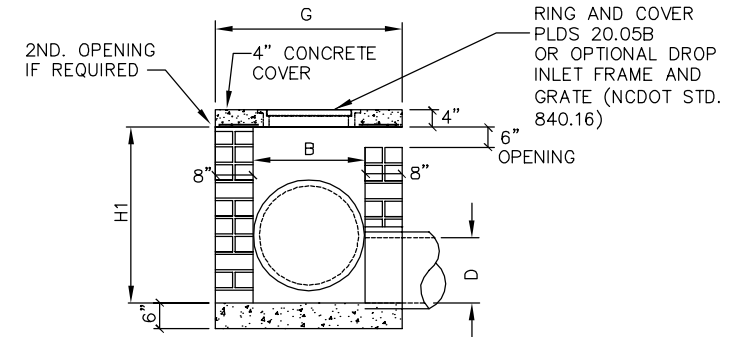

SECTION Y-Y

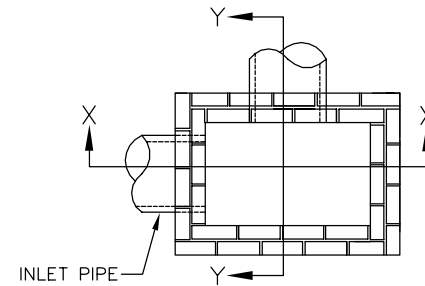

PLAN

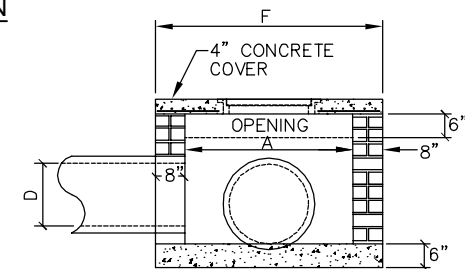

SECTION X-X




TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

SLAB TYPE CATCH BASIN

15" THRU 48" PIPE

8/1/19


STD. NO.	REV.
20.05A	3

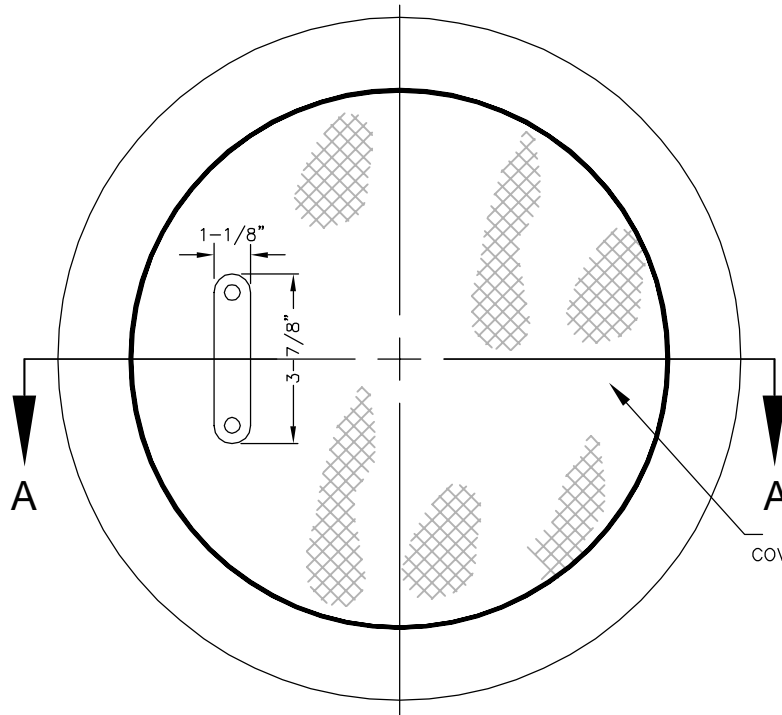

PLAN VIEW

MINIMUM WEIGHT	
RING	96 LBS
COVER	86 LBS

DIAMOND PATTERN SOLID
COVER OR ROUND GRATE COVER

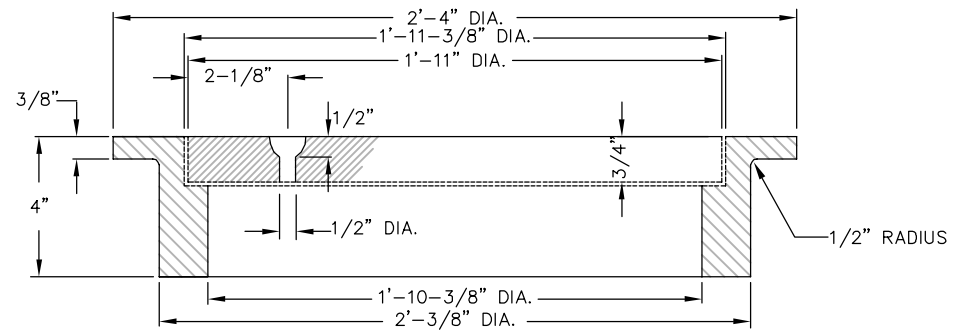

SECTION A-A

NOT TO SCALE




TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

MANHOLE RING AND COVER FOR
SLAB TYPE CATCH BASIN


STD. NO.	REV.
20.05B	

CONCRETE PIPE			DIMENSIONS									
WALL THK.	OUT DIA.	IN DIA.	H	A	B	C	E	F	G	W	K	M
2 1/4"	19 1/2"	15"	27 1/2"	20"	24"	8"	7 1/2"	4"	4"	8"	17"	10"
2 1/2"	23"	18"	31"	20"	24"	8"	9"	4"	4"	8"	17"	12"
3"	30"	24"	38"	20"	30"	8"	12"	4"	4"	8"	21"	15"
3 1/2"	37"	30"	45"	20"	44"	12"	15"	6"	8"	8"	31"	18"
4"	44"	36"	52"	32"	44"	12"	18"	6"	8"	8"	31"	22"
4 1/2"	51"	42"	59"	32"	48"	12"	21"	6"	8"	8"	34"	26"
5"	58"	48"	66"	32"	48"	12"	24"	6"	8"	8"	34"	29"
5 1/2"	65"	54"	73"	32"	54"	12"	27"	6"	8"	8"	38"	33"
6"	72"	60"	80"	36"	66"	12"	30"	8"	12"	12"	46"	36"
6 1/2"	79"	66"	87"	36"	72"	12"	33"	8"	12"	12"	51"	40"
7"	86"	72"	94"	36"	78"	12"	36"	8"	12"	12"	56"	43"

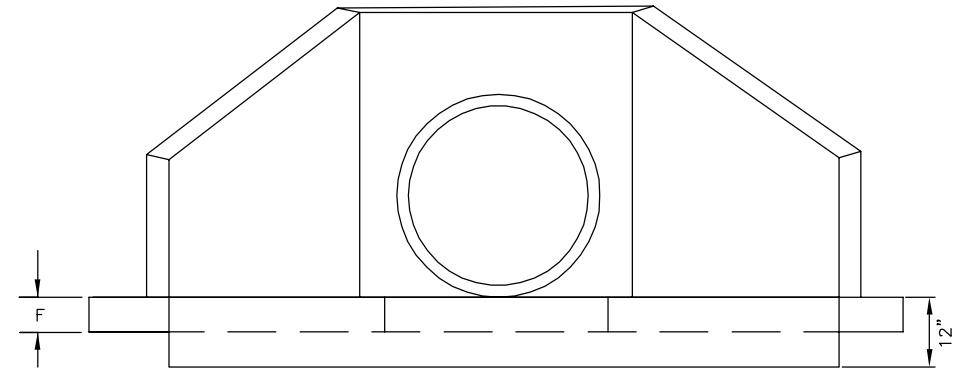


FRONT VIEW

REINFORCING				
DIA.	"C" BAR		"D" BAR	
	NO.	LGT.	NO.	LGT.
15"	4	2'-0"	4	1'-11"
18"	4	2'-3"	4	2'-2"
24"	4	2'-9"	4	2'-8"
30"	4	3'-3"	4	3'-2"
36"	4	3'-9"	4	3'-8"
42"	4	4'-3"	4	4'-2"
48"	4	4'-9"	4	4'-8"
54"	4	5'-3"	4	5'-2"
60"	4	5'-9"	4	5'-8"
66"	4	6'-3"	4	6'-2"
72"	4	6'-9"	4	6'-8"

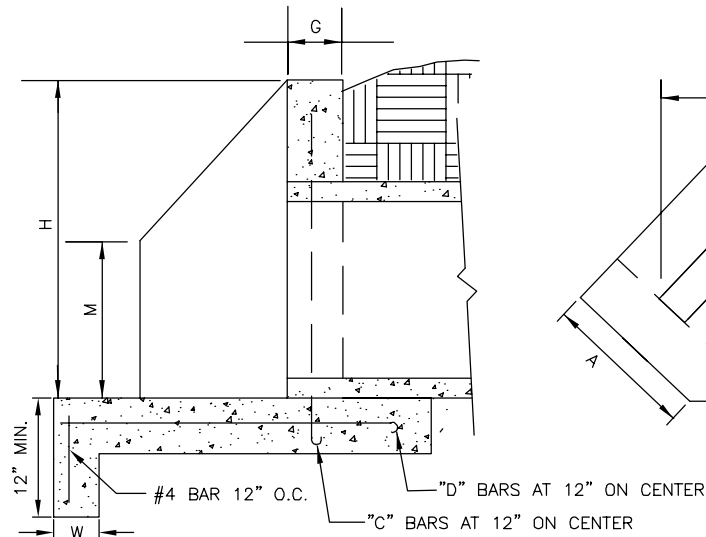

SIDE VIEW

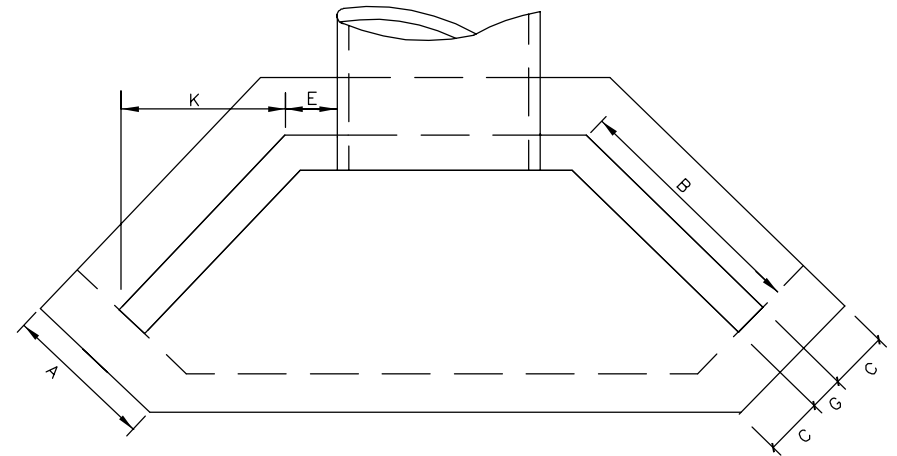

TOP VIEW

NOT TO SCALE



TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

CONCRETE WINGWALL WITH SPLASH PAD

STD. NO.	REV.
20.17A	

GENERAL NOTES:

1. ALL CORNERS TO BE CHAMFERED 1" IF CONCRETE.
2. THE CONTRACTOR WILL BE REQUIRED TO PLACE 2-#6 BARS "Y" IN THE TOP OF ALL ENDWALL FOR PIPE CULVERTS 42" AND OVER WITH A MINIMUM 3" COVER AND A LENGTH OF 6" LESS THAN ENDWALL.
3. FORMS ARE TO BE USED FOR THE CONSTRUCTION OF THE BOTTOM SLAB.
4. WALL THICKNESS (T) SHOWN IS NOT TO BE INTERPRETED TO MEAN THE THICKNESS ACCEPTABLE, BUT IS USED ONLY IN COMPUTING ENDWALL QUANTITIES.
5. IF CONTRACTOR ELECTS TO USE CONSTRUCTION JOINT AT BOTTOM OF PIPE, AND POURS BASE SEPARATELY, THE TOP OF BASE SHALL BE LEFT ROUGH.
6. ALL CONCRETE TO BE 3600 P.S.I COMPRESSIVE STRENGTH.

NOT TO SCALE



TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

CONCRETE WINGWALL WITH SPLASH PAD NOTES

STD. NO.	REV.
20.17B	



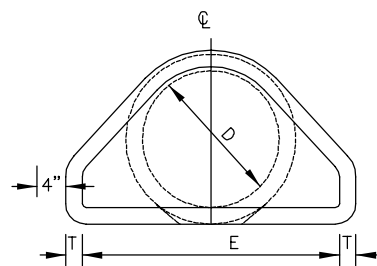


TABLE OF DIMENSIONS							
D	T	A	B	C	E	L	WT.
12"	2-1/4"	4"	2'-0"	4'-1"	2'-0"	6'-1"	730
15"	2-1/4"	6"	2'-3"	3'-10"	2'-0"	6'-1"	730
18"	2-1/2"	9"	2'-3"	3'-10"	3'-0"	6'-1"	1190
24"	3"	10"	3'-8"	2'-6"	4'-0"	6'-2"	1770
30"	3-1/2"	1'-0"	4'-6"	1'-8"	5'-0"	6'-2"	2380
36"	4"	1'-3"	5'-3"	2'-11"	6'-0"	8'-2"	5320
42"	4-1/2"	1'-9"	5'-3"	2'-11"	6'-6"	8'-2"	5920
48"	5"	2'-0"	6'-0"	2'-2"	7'-0"	8'-2"	7470
54"	5-1/2"	2'-3"	5'-6"	2'-10"	7'-6"	8'-4"	8810
60"	6"	2'-6"	5'-0"	3'-3"	8'-0"	8'-3"	11180
66"	6-1/2"	3'-0"	6'-0"	2'-3"	8'-6"	8'-3"	12530
72"	7"	3'-0"	6'-6"	1'-9"	9'-0"	8'-3"	13980

GENERAL NOTES:

1. REINFORCEMENT SHALL CONFORM TO THE REQUIREMENTS OF REINFORCED CONCRETE PIPE OF LIKE DIAMETER PER AASHTO M170, TABLE 2, WALL B.
2. ALL CONCRETE TO BE 3600 P.S.I COMPRESSIVE STRENGTH.
3. PROVIDE TONGUE OR SPIGOT JOINT AT INLET END SECTION.
4. PROVIDE GROOVE OR BELL JOINT AT OUTLET END SECTION.
5. THE DIMENSIONS FOR END SECTIONS SHALL SUBSTANTIALLY AGREE WITH THE TABLE. MINOR VARIATIONS WILL BE PERMITTED BASED ON THE MANUFACTURER'S STANDARD FORMS AND TEMPLATES.
6. NOT TO BE USED IN NCDOT MAINTAINED RIGHT OF WAY.

NOT TO SCALE

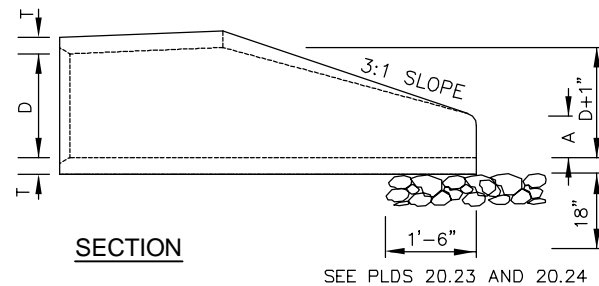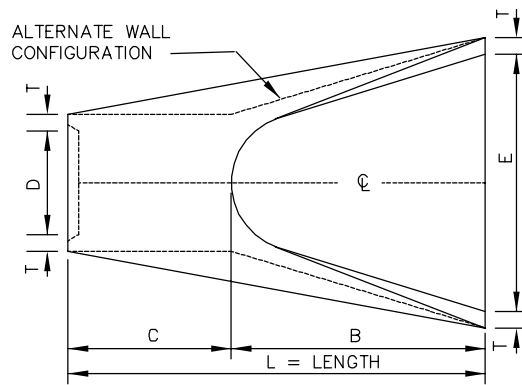

TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

FLARED END SECTION
12" THRU 72" PIPE

8/1/19

STD. NO.	REV.
20.22	3


NOTES:

1. CLASS OR MEDIAN SIZE OF RIPRAP AND LENGTH, WIDTH AND DEPTH OF APRON TO BE DESIGNED BY THE ENGINEER.
2. REFER TO THE CHARLOTTE MECKLENBURG STORM WATER DESIGN MANUAL FOR RIPRAP APRON DESIGN STANDARDS.
3. RIPRAP SHOULD EXTEND UP BOTH SIDES OF THE APRON AND AROUND THE END OF THE PIPE OR CULVERT AT THE DISCHARGE OUTLET AT A MAXIMUM SLOPE OF 2:1 AND A HEIGHT NOT LESS THAN TWO THIRDS THE PIPE DIAMETER OR CULVERT HEIGHT.
4. THERE SHALL BE NO OVERFLOW FROM THE END OF THE APRON TO THE SURFACE OF THE RECEIVING CHANNEL. THE AREA TO BE PAVED OR RIPRAPPED SHALL BE UNDERCUT SO THAT THE INVERT OF THE APRON SHALL BE AT THE SAME GRADE (FLUSH) WITH THE SURFACE OF THE RECEIVING CHANNEL. THE APRON SHALL HAVE A CUTOFF OR TOE WALL AT THE DOWNSTREAM END.
5. THE WIDTH OF THE END OF THE APRON SHALL BE EQUAL TO THE BOTTOM WIDTH OF THE RECEIVING CHANNEL. MAXIMUM TAPER TO RECEIVING CHANNEL 5:1
6. ALL SUBGRADE FOR STRUCTURE TO BE COMPACTED TO 95% OR GREATER.
7. THE PLACING OF FILL, EITHER LOOSE OR COMPACTED IN THE RECEIVING CHANNEL SHALL NOT BE ALLOWED.
8. NO BENDS OR CURVES IN THE HORIZONTAL ALIGNMENT OF THE APRON WILL BE PERMITTED.
9. FILTER FABRIC SHALL BE INSTALLED ON COMPACTED SUBGRADE PRIOR TO PLACEMENT OF RIP RAP.
10. ANY DISTURBED AREA FROM END OF APRON TO RECEIVING CHANNEL MUST BE STABILIZED.


USE USDA NOMOGRAPH FROM NC SEDIMENT AND EROSION CONTROL MANUAL FOR DESIGN DATA.

OUTLET	L _a	W ₁	W ₂	*T	H


* d50 (see fig 8.06 a&b "NC SEDIMENT AND EROSION CONTROL MANUAL")
dmax = 1.5 x d50
T = 1.5 X dmax.
T(min.)=10"

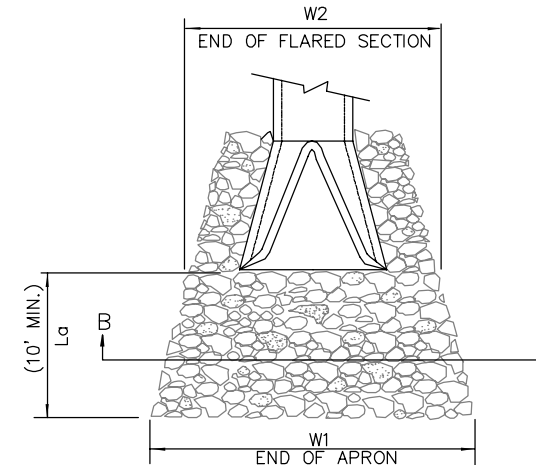

PLAN

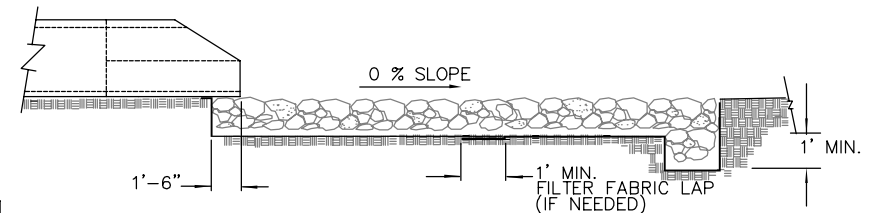

ELEVATION

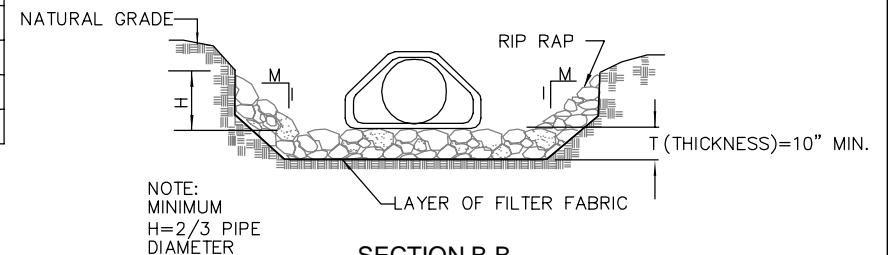

SECTION B-B


NOT TO SCALE




**TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS**

**RIPRAP APRON AT PIPE OUTFALLS
OTHER THAN AT CREEK BUFFERS**

STD. NO.	REV.
20.23	

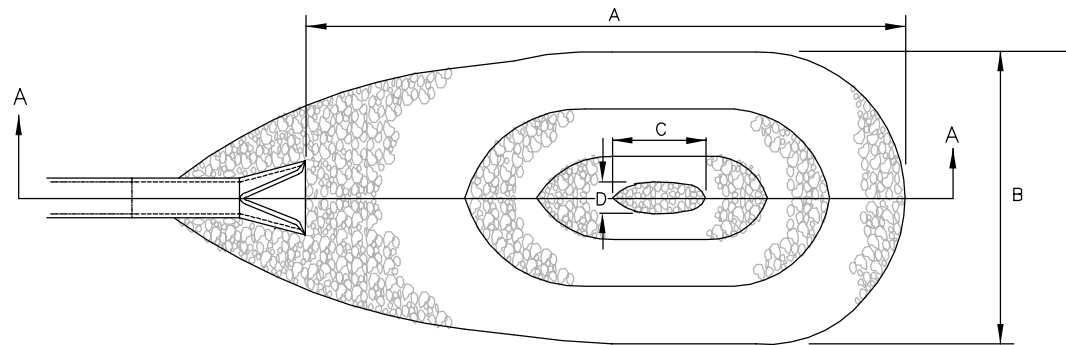

PLAN

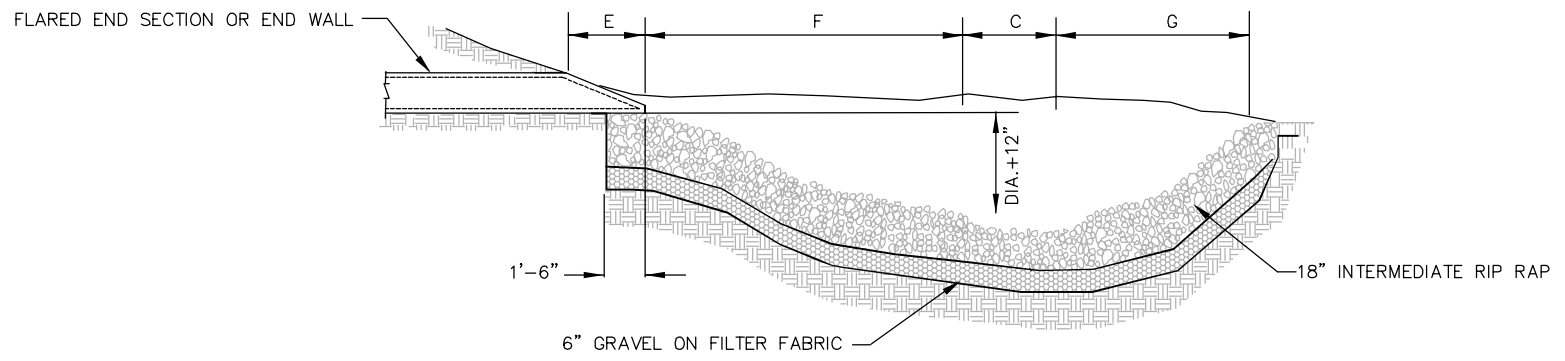

SECTION A-A

GENERAL NOTES:

1. THIS DETAIL IS TO ONLY BE USED WHEN OUTFALL HAS A CONTINUOUS FLOW OF WATER AND WITH PRIOR APPROVAL OF THE TOWN ENGINEER.

PIPE SIZE	A	B	C	D	E	F	G	WT. RIP RAP IN TONS
15"	10'	7'	1 1/2'	1'	1'	4 1/2'	3'	6
18"	12'	8'	2'	1'	1'	5'	4'	8
21"	15'	9'	2 1/2'	1 1/2'	1'	7'	4 1/2'	12
24"	17'	10'	2 1/2'	1 1/2'	1'	8'	5 1/2'	15
30"	20'	13'	3'	2'	2'	9'	6'	22
36"	24'	16'	3 1/2'	2'	2'	9 1/2'	7'	33

NOT TO SCALE




**TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS**

RIP RAP PLUNGE POOL

STD. NO.	REV.
20.24	

NOTES:

1. A MINIMUM OF 24" FROM OUTSIDE DIAMETER OF PIPE TO SIDE OF TRENCH MUST BE ALLOWED FOR COMPACTION OF FILL MATERIAL. BACKFILLING OF TRENCHES SHALL BE ACCOMPLISHED IMMEDIATELY AFTER THE PIPE IS LAID. THE FILL AROUND THE PIPE SHALL BE PLACED IN LAYERS NOT TO EXCEED 6". UNDER NO CIRCUMSTANCES SHALL WATER BE PERMITTED TO RISE IN UNBACKFILLED TRENCHES AFTER THE PIPE HAS BEEN PLACED. COMPACTION REQUIREMENTS SHALL BE ATTAINED BY THE USE OF MECHANICAL TAMPS ONLY. EACH AND EVERY LAYER OF BACKFILL SHALL BE PLACED LOOSE AND THOROUGHLY COMPACTED INTO PLACE.
2. ALL BACKFILL MATERIAL SHALL HAVE AN IN PLACE COMPACTED DENSITY OF 95% STANDARD PROCTOR.
3. THE FINAL 2' BELOW FINISHED GRADE SHALL BE 100%.
4. ALL TRENCHING OPERATIONS SHALL MEET OSHA STANDARDS.
5. BACKFILL MATERIAL BENEATH ROADWAY SHALL BE SELECT BACKFILL MATERIAL.

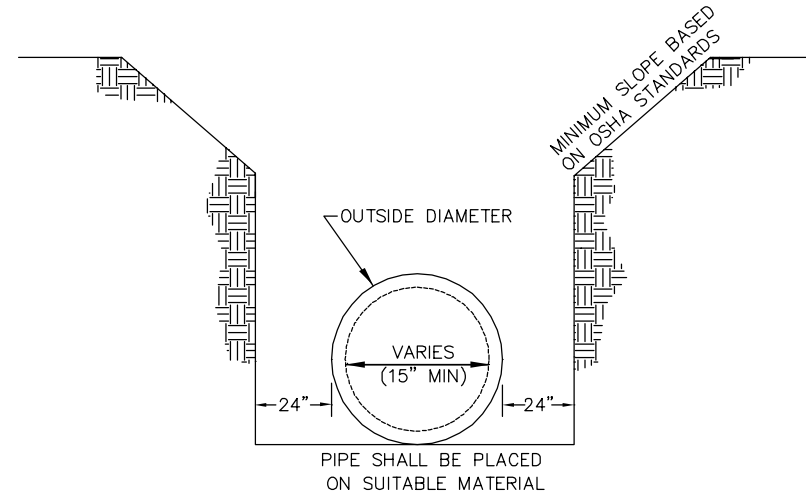


NOT TO SCALE




**TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS**

TRENCH DRAIN FOR STORM DRAIN


STD. NO.	REV.
20.25	

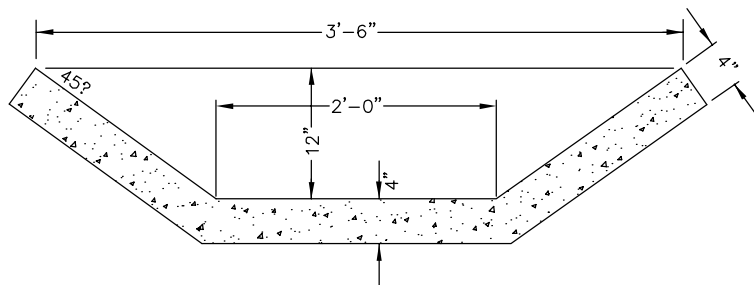

SLOPE DRAIN, BASE DITCH OR BERM DRAINAGE
OUTLET DITCH

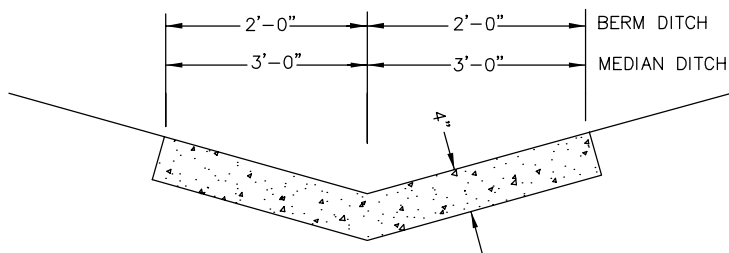


MEDIAN OR BERM DITCH

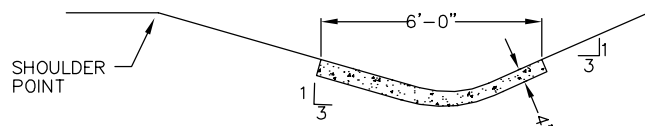

SIDE DITCH


GENERAL NOTES:

1. IN THE 4" CONCRETE PAVED DITCHES PLACE 1/2" EXPANSION JOINT AT 30 FT INTERVALS AND AT ALL OTHER POINTS WHERE PROPOSED DITCHES ABUT RIGID OBJECTS. PLACE GROOVED JOINTS 1" DEEP AT 10' INTERVALS BETWEEN EXPANSION JOINTS.
2. WIDTH AND SHAPE OF PROPOSED 4" CONCRETE PAVED DITCHES SHALL BE AS SHOWN OR AS DIRECTED BY THE ENGINEER.
3. ALL CONCRETE TO BE 3600 P.S.I. COMPRESSIVE STRENGTH.

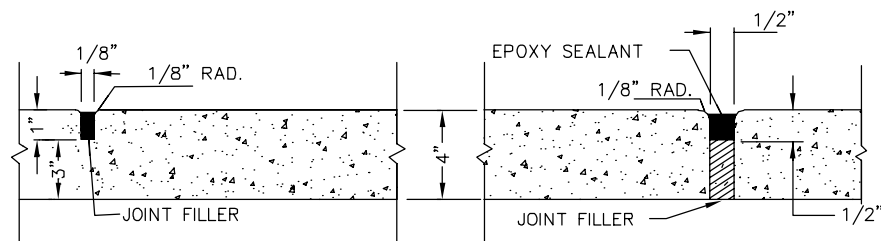

SHOWING GROOVED JOINT

SHOWING EXPANSION JOINT

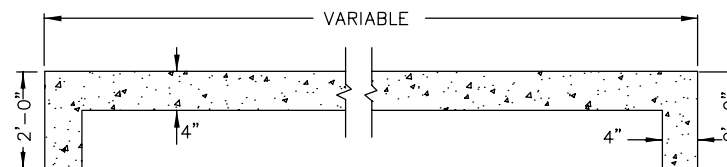

LONGITUDINAL SECTION OF PAVED DITCH

SHOWING 2'-0" CURTAIN WALL REQUIRED AT EACH END




NOT TO SCALE



TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

CONCRETE PAVED DITCHES

STD. NO.	REV.
20.26	

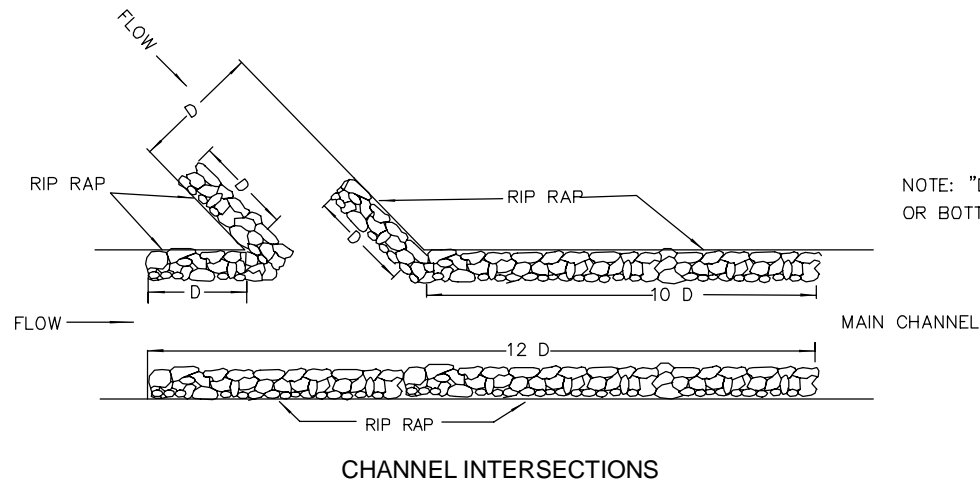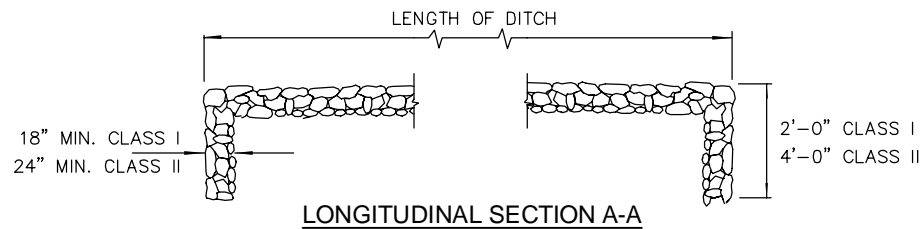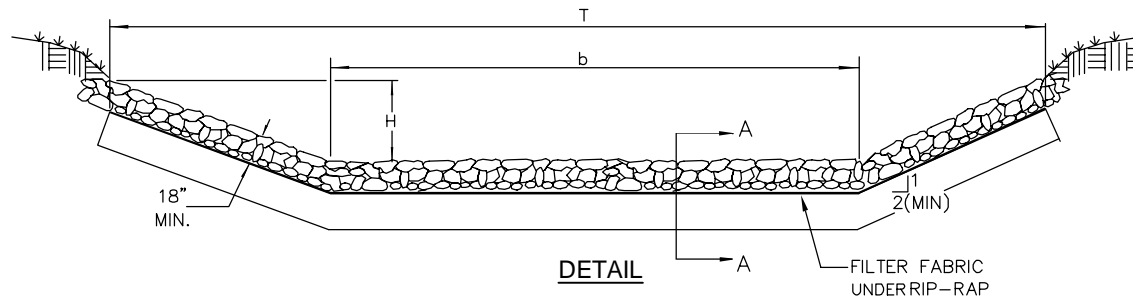

GENERAL NOTES:

1. IF BEDROCK IS ENCOUNTERED WITHIN THE LIMITS OF THE TOEWALL, BEGIN TOEWALL ON THE BEDROCK OR AS DIRECTED BY THE ENGINEER.
2. WHERE ONLY ONE SIDE REQUIRES RIP RAP CLASS I OR II, LIST STATION AND SIDE OF SAME.
3. CHANNEL AND RIP RAP SIZE TO BE DESIGNED BY THE ENGINEER.
4. DEPENDING ON SOIL CONDITIONS, WASHED STONE AND FILTER FABRIC MAY BE NECESSARY UNDER RIP RAP.
5. CHANNEL DEPTH "H" SHALL INCLUDE A MINIMUM 6" OF FREEBOARD.

NOTE: "D" EQUALS DIAMETER OF PIPE OR BOTTOM WIDTH OF CHANNEL.

NOT TO SCALE




TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

RIP RAP DITCHES

STD. NO.	REV.
20.27	

NOTES:

1. A MINIMUM OF 6" FROM OUTSIDE DIAMETER OF PIPE TO SIDE OF TRENCH MUST BE ALLOWED FOR WASHED STONE. THE METHOD OF COMPACTING BACKFILL MATERIAL IS SUBJECT TO APPROVAL BY THE TOWN ENGINEER. AN APPROVED FILTER FABRIC SHALL BE PLACED AROUND STONE AND OVERLAPPED 8" AT TOP WITHIN STREET RIGHT OF WAY.
2. SUBDRAIN IS TO BE A MINIMUM 6" DIAMETER PERFORATED PIPE; USE SCHEDULE 40 PVC PER ASTM D1785 OR HDPE PER AASHTO M252, TYPE CP (SINGLE-WALL, CORRUGATED) OR TYPE SP (DOUBLE-WALL, SMOOTH INTERIOR).
3. OUTLET PIPE FROM SUBDRAIN SHALL BE NON-PERFORATED UNDER PAVEMENT (INCLUDING SIDEWALKS AND DRIVEWAYS). SEE SITE PLAN FOR SLOPE OF SUBDRAIN AND TIE IN TO STORM DRAINAGE.
4. THE OUTLET PIPES SHALL BE SCHEDULE 40 (MIN.) PVC PER ASTM D2665 OR HDPE PER AASHTO M252, TYPE S (DOUBLE WALL, SMOOTH INTERIOR) UNDER ROADWAYS.
5. FILTER FABRIC SHALL BE AN APPROVED, TYPE 2 WATER PERMEABLE, SYNTHETIC FABRIC.
6. A MINIMUM 4" DIAMETER SUBDRAIN MAY BE USED IN PLANTING AREAS AS DESCRIBED IN THE PLDSM 4000 SERIES.
7. CLEAN-OUTS ARE RECOMMENDED AT ALL PIPE INTERSECTIONS AND AT A 100' MAXIMUM SEPARATION.
8. SUBDRAIN INVERTS AT CATCH BASINS SHOULD BE INSTALLED ABOVE THE BOTTOM TO AVOID SURCHARGE OF SUBDRAIN SYSTEM.
9. ALL SUBDRAINS WILL TIE INTO A STANDARD DRAINAGE STRUCTURE OR DAYLIGHT TO THE SURFACE WHERE APPROPRIATE.

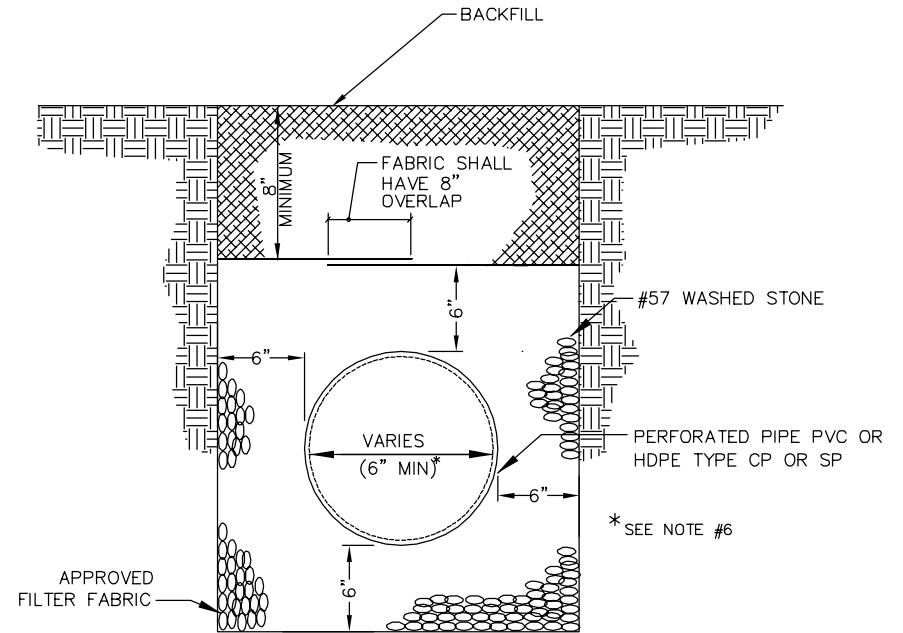

SPECIAL NOTE:

PREFABRICATED DRAINAGE MAY BE USED WITH APPROVAL OF TOWN ENGINEER.

NOT TO SCALE




**TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS**

SUBDRAIN DETAIL


8/1/19

STD. NO.	REV.
20.28	3

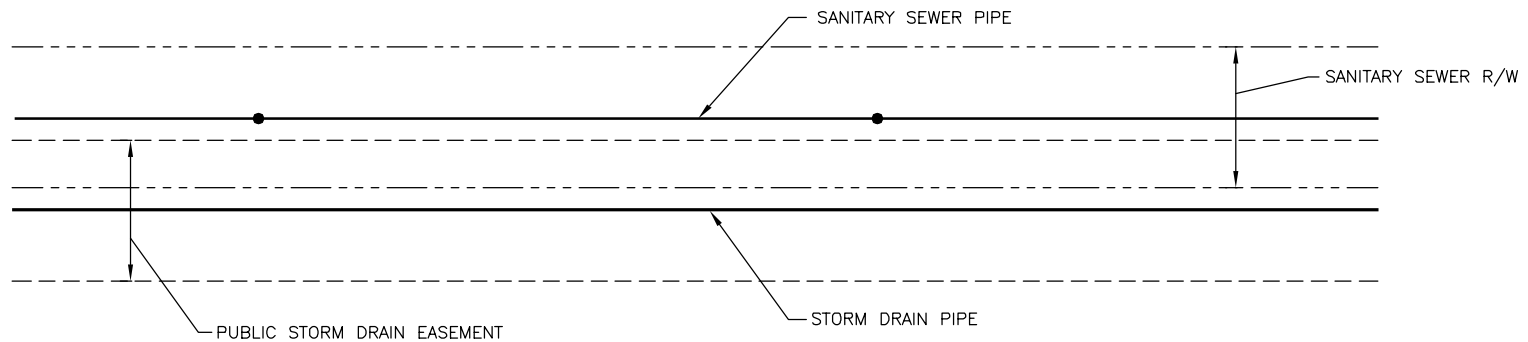


THE SANITARY SEWER AND STORM DRAINAGE EASEMENTS MAY OVERLAP; HOWEVER THE PIPE AND ASSOCIATED STRUCTURES MUST NOT BE IN THE OTHER UTILITY'S RIGHT OF WAY. THE SANITARY SEWER EASEMENT WIDTHS SHALL BE AS OUTLINED IN AGENCY'S DESIGN MANUAL. THIS DETAIL DOES NOT APPLY TO STORM DRAINAGE UTILIZING OPEN CHANNEL FLOW.

PLAN VIEW

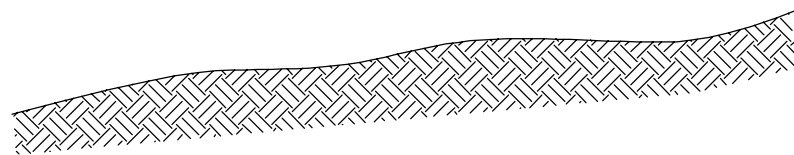

THE VERTICAL SEPARATION GUIDELINE WILL BE USED UP TO THE POINT WHERE THE TWO RIGHTS OF WAY ADJOIN EACH OTHER.

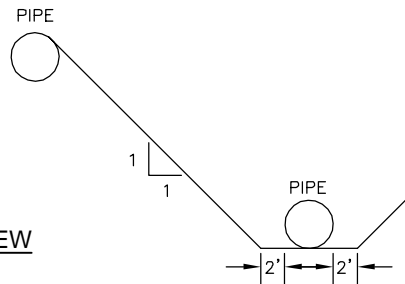

PROFILE VIEW

THE SANITARY SEWER AND STORM DRAINAGE PIPES MUST BE NO CLOSER TOGETHER HORIZONTALLY THAN THE VERTICAL DISTANCE BETWEEN THE TOP OF THE HIGHER PIPE AND THE BOTTOM OF THE LOWER PIPE. A MAINTENANCE CREW MUST BE ABLE TO DIG DOWN TO THE LOWER PIPE SLOPING THE DITCH ON A 1:1 SLOPE UP FROM THE REQUIRED TRENCH BOTTOM WIDTH AND NOT EXPOSE THE HIGHER PIPE.

NOT TO SCALE



TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

OVERLAPPING STORM DRAINAGE/SANITARY
SEWER EASEMENTS

STD. NO.	REV.
20.29	

GENERAL NOTES:

1. FOR STREAMS CARRYING 500 ACRES OR MORE OF SURFACE RUNOFF, THE EASEMENT REQUIREMENT IS TO BE THE WIDTH OF THE STREAM FROM TOP OF BANK TO TOP OF BANK, PLUS (+) 10' ON EACH SIDE OF STREAM. (40' MINIMUM WIDTH)
2. FOR OPEN CHANNELS THE MINIMUM EASEMENT MUST CONTAIN THE WIDTH OF THE STREAM FROM TOP OF BANK TO TOP BANK.
3. WIDER EASEMENT WIDTHS MAY BE REQUIRED FOR PIPE DEPTHS GREATER THAN TEN FEET.
4. PIPE SYSTEMS AND OPEN CHANNELS ON PRIVATE PROPERTY SHALL BE PLACED IN A PUBLIC STORM DRAINAGE EASEMENT.

**EASEMENT REQUIREMENTS FOR
OPEN STORM DRAINAGE CHANNELS**

AREA IN ACREAGE	EASEMENT REQUIREMENT
0–45 AC.	20'
45–120 AC.	30'
120–500 AC.	40'
500 AC.+	SEE NOTE

EASEMENT REQUIREMENTS FOR STORM DRAIN PIPE

PIPE SIZE	EASEMENT REQUIREMENT
15"	15'
18"	15'
24"	15'
30"	20'
36"	20'
42"	25'
48"	25'
54"+	30' MIN (VARIES)


NOT TO SCALE



**TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS**

**MINIMUM DRAINAGE EASEMENT
REQUIREMENTS FOR STORM DRAIN
PIPES AND OPEN CHANNELS**


STD. NO.	REV.
20.30	

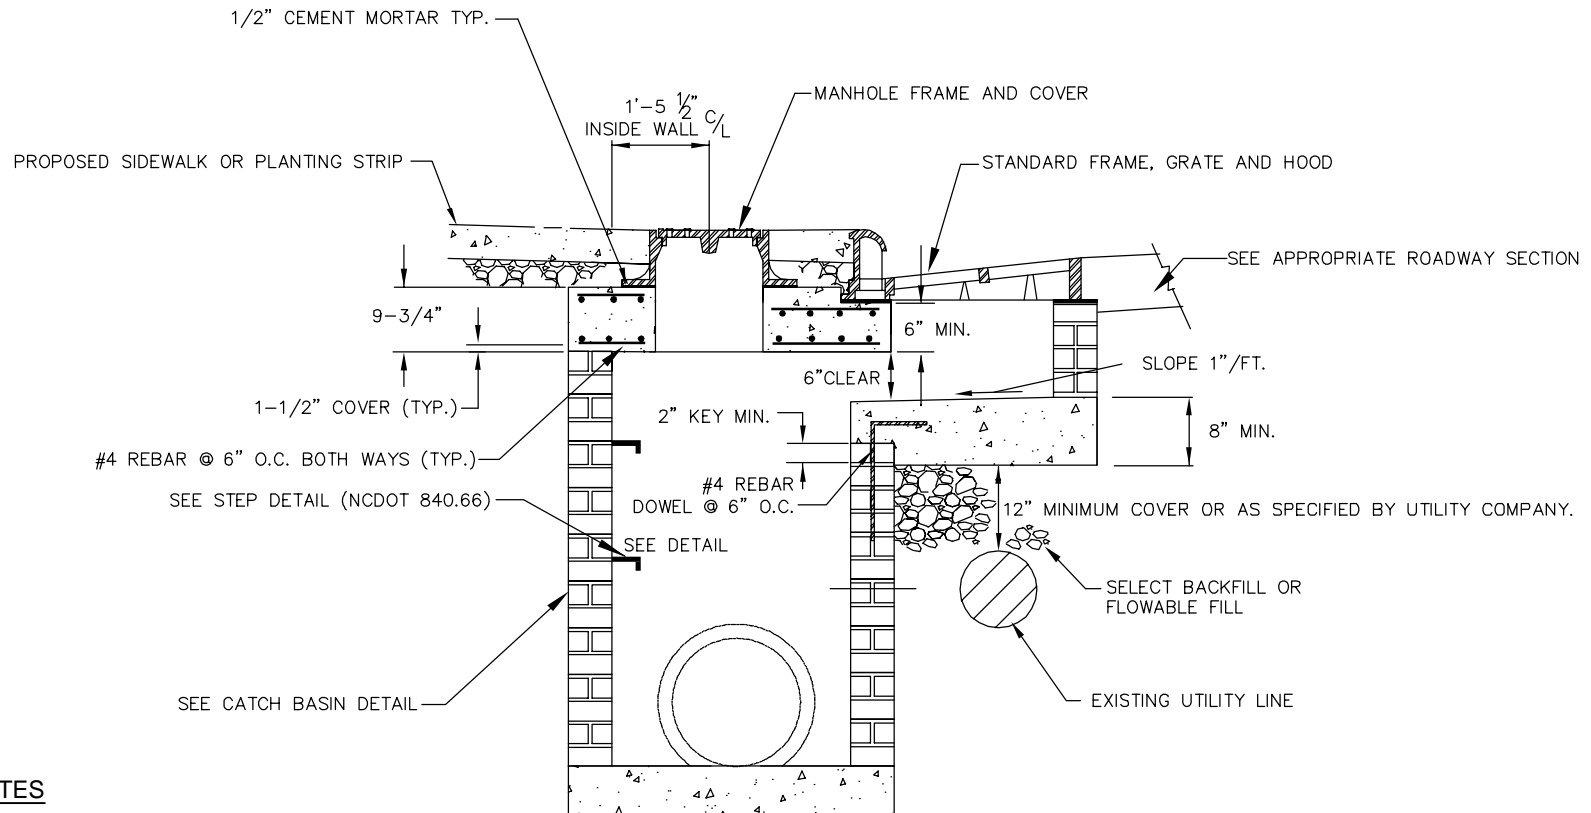

NOTES

1. PRIOR APPROVAL FROM THE TOWN ENGINEER IS REQUIRED.
2. THIS STRUCTURE IS TO ONLY BE USED ON TOWN MAINTAINED STREETS AND NOT ON NCDOT STREETS WITHOUT THEIR PERMISSION.

OFFSET CATCH BASIN EXISTING UTILITY CONFLICT



DOWEL DETAIL



NOT TO SCALE



TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

OFFSET CATCH BASIN

STD. NO.	REV.
20.34	

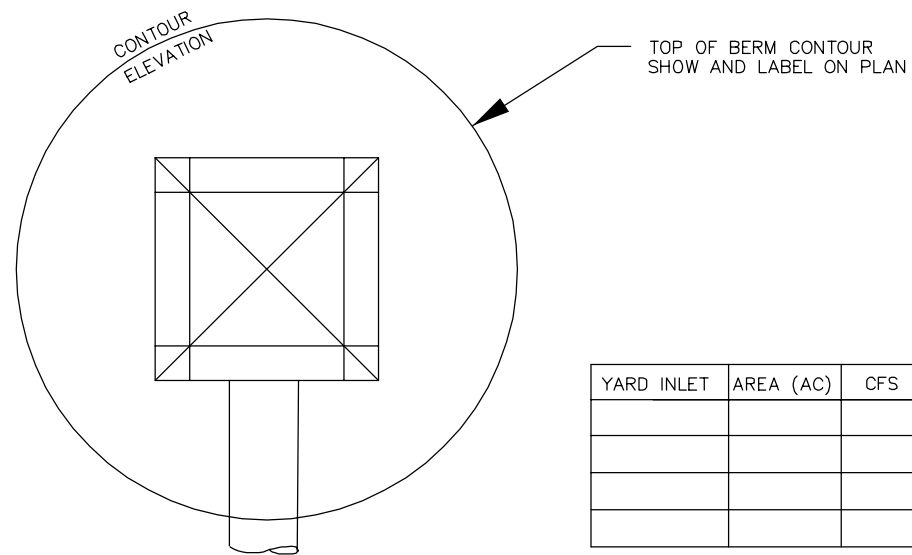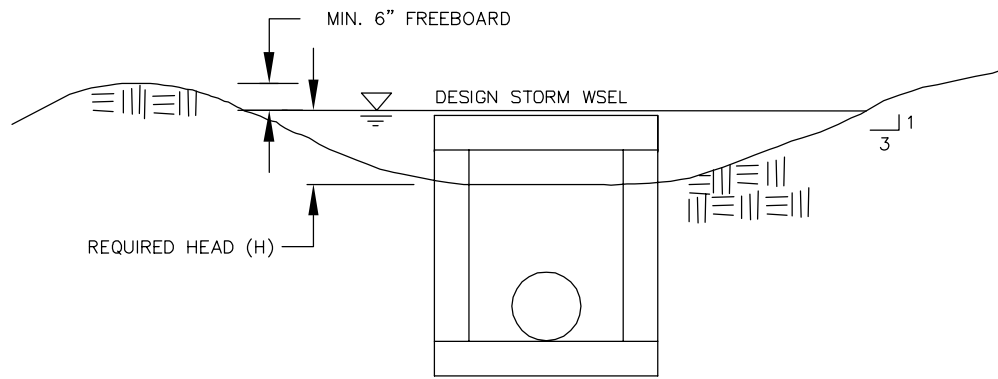

YARD INLET	AREA (AC)	CFS	HEAD H (FT)	COMMENT


NOT TO SCALE



TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS

GRADING AT DROP INLET

STD. NO.	REV.
20.35	

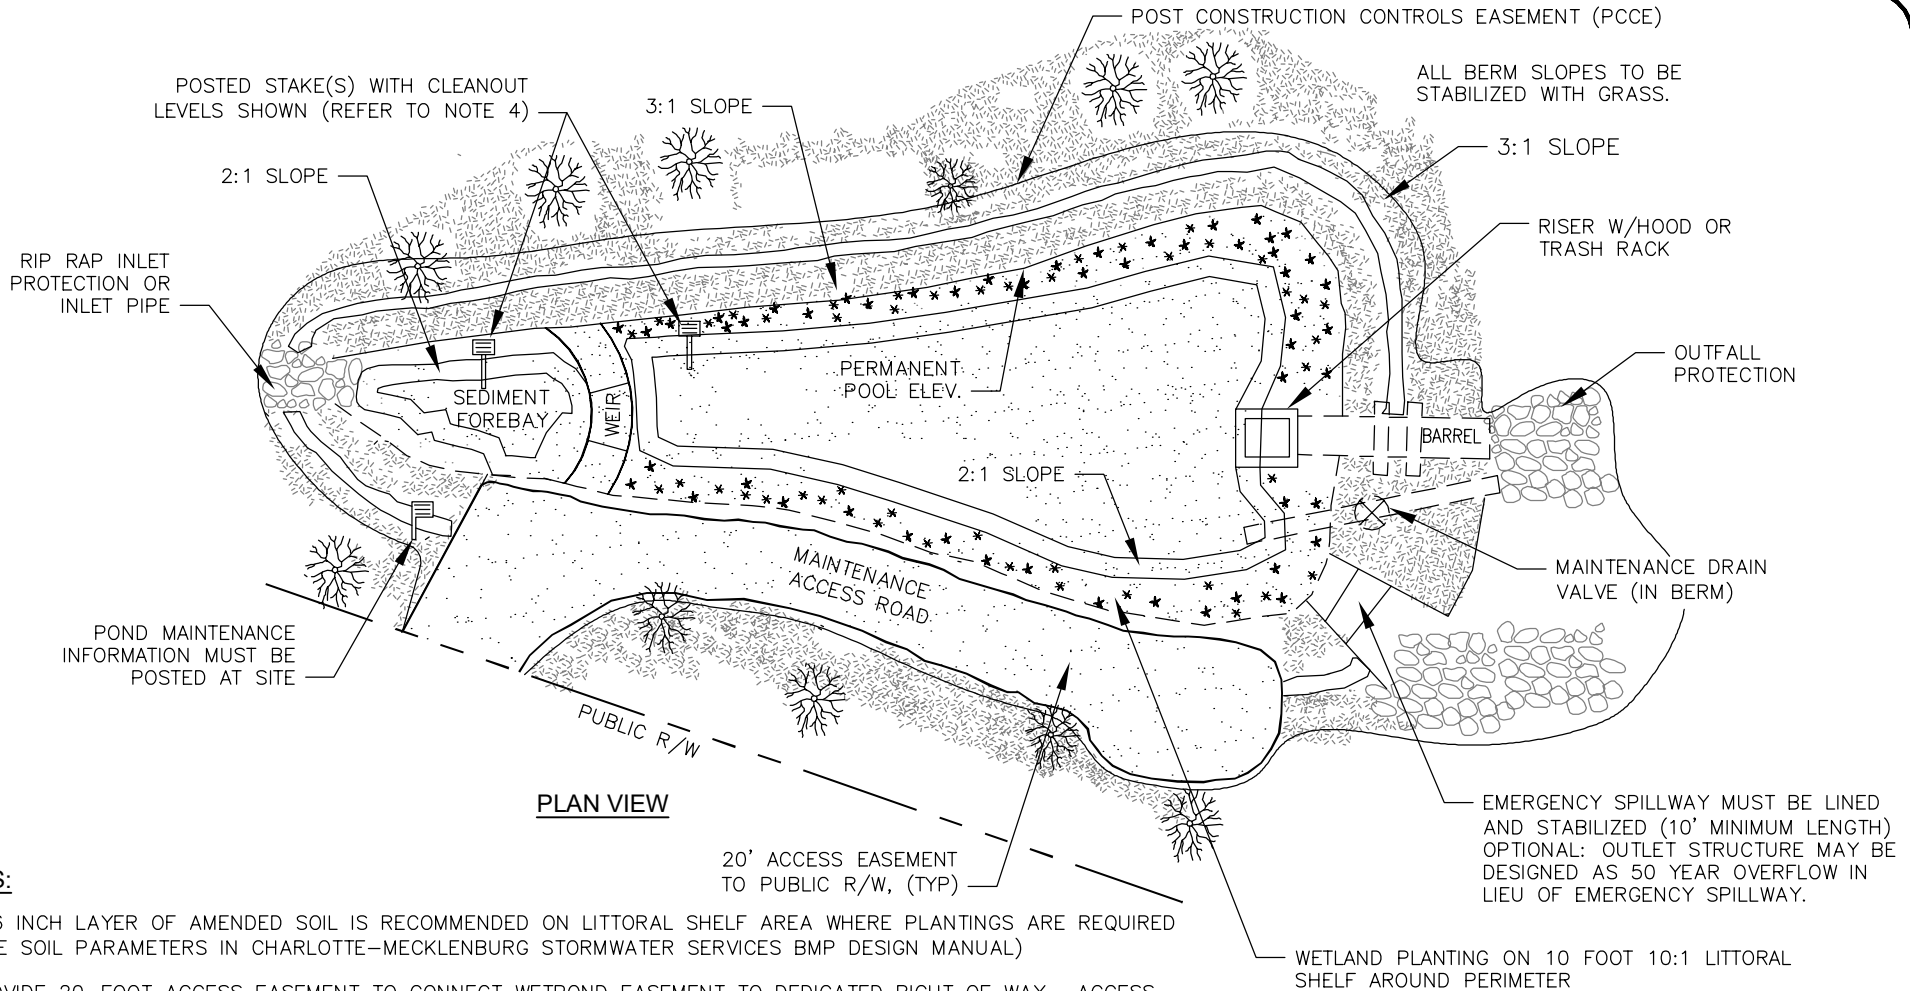

NOTES:

1. 4-6 INCH LAYER OF AMENDED SOIL IS RECOMMENDED ON LITTORAL SHELF AREA WHERE PLANTINGS ARE REQUIRED (SEE SOIL PARAMETERS IN CHARLOTTE-MECKLENBURG STORMWATER SERVICES BMP DESIGN MANUAL)
2. PROVIDE 20-FOOT ACCESS EASEMENT TO CONNECT WETPOND EASEMENT TO DEDICATED RIGHT OF WAY. ACCESS ROAD SHALL HAVE MIN. 12' STABILIZED WIDTH, MAX. LONG. GRADE OF 15%, MAX. CROSS-SLOPE 5%.
3. A 10-FOOT WIDE PERMANENT MAINTENANCE ACCESS EASEMENT MUST BE PROVIDED AROUND THE PERIMETER OF ALL BMPs TO ALLOW FOR ADEQUATE MAINTENANCE AND REPAIR.
4. WITHIN THE FOREBAY AND MAIN POND AREAS. THE OVERALL STAKE HEIGHT MUST BE HIGHER THAN PERMANENT POOL ELEVATION FOR VISIBILITY. THERE SHALL BE MARKINGS/COLORATIONS/NOTATIONS THAT CLEARLY INDICATE THE MAXIMUM SEDIMENT LEVEL BEFORE CLEANOUT IS REQUIRED. WITH THIS BMP, THE MAXIMUM SEDIMENT LEVEL CAN NOT BE GREATER THAN 50% OF THE FOREBAY CAPACITY AND IN THE MAIN POND AREA THE SEDIMENT CAN NOT BE GREATER THAN 25% OF THE MAIN POND STORAGE CAPACITY. THESE SURVEYED LEVELS TO BE CALLED OUT ALSO ON THE PLANS FOR REFERENCE.

NOT TO SCALE



**TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS**

**WETPOND PLAN
BMP FIG. 4.2.2**

REV. DATE	
4/2/21	
STD. NO.	REV.
21.05	5

1. 4-6 INCH LAYER OF AMENDED SOIL IS REQUIRED ON ANY MARSH AREA WHERE PLANTINGS ARE REQUIRED (SEE SOIL PARAMETERS IN CHARLOTTE-MECKLENBURG STORMWATER SERVICES BMP DESIGN MANUAL)
2. PROVIDE 20' ACCESS EASEMENT TO CONNECT WETLAND EASEMENT TO DEDICATED RIGHT OF WAY.
3. ALL WETLANDS SHALL HAVE A MINIMUM 20 FOOT ACCESS EASEMENT CONNECTING TO A DEDICATED PUBLIC RIGHT OF WAY. ACCESS ROAD SHALL HAVE MIN. 12' STABILIZED WIDTH, MAX. LONG. GRADE OF 15%, MAX. CROSS-SLOPE 5%.
4. A 10-FOOT WIDE PERMANENT MAINTENANCE ACCESS EASEMENT MUST BE PROVIDED AROUND THE PERIMETER OF ALL BMPS TO ALLOW FOR ADEQUATE MAINTENANCE AND REPAIR.
5. PERMANENT STAKE MUST BE POSTED WITHIN THE FOREBAY. THE OVERALL STAKE HEIGHT MUST BE HIGHER THAN PERMANENT POOL ELEVATION FOR VISIBILITY. THERE SHALL BE MARKINGS/COLORATIONS/NOTATIONS ON THE STAKE THAT CLEARLY INDICATE THE MAXIMUM SEDIMENT LEVEL BEFORE CLEANOUT IS REQUIRED. THESE SURVEYED LEVELS TO BE CALLED OUT ALSO ON THE PLANS FOR REFERENCE.





TOWN OF PINEVILLE LAND DEVELOPMENT STANDARDS

WETPOND PLAN
BMP FIG. 4.3.2

REV. DATE	
4/2/21	
STD. NO.	REV.
21.10	5

NOTES:

1. ALL SAND FILTERS SHALL HAVE A MINIMUM 20 FOOT ACCESS EASEMENT CONNECTING TO A DEDICATED PUBLIC RIGHT OF WAY. ACCESS ROAD SHALL HAVE MIN. 12' STABILIZED WIDTH, MAX. LONG. GRADE OF 15%, MAX. CROSS-SLOPE 5%. IN ADDITION, A 10-FOOT WIDE PERMANENT MAINTENANCE ACCESS EASEMENT MUST BE PROVIDED AROUND THE PERIMETER OF ALL BMPs TO ALLOW FOR ADEQUATE MAINTENANCE AND REPAIR.
2. ALL DRAINAGE AREAS TO A SAND FILTER FACILITY ARE TO BE STABILIZED PRIOR TO INSTALLATION OF SAND.
3. CLEAN OUTS IN THE UNDERDRAIN SYSTEM ARE TO BE PROVIDED EVERY 50' AND AS DETERMINED BY THE COUNTY REVIEWER. CLEAN OUTS SHALL HAVE WATER TIGHT, VANDAL PROOF CAPS AND EXTEND 6" ABOVE THE SURFACE.
4. A PERMANENT STAKE MUST BE POSTED IN THE PRETREATMENT AREA. THERE SHALL BE MARKINGS/NOTATIONS THAT CLEARLY INDICATE THE MAXIMUM SEDIMENT LEVEL BEFORE CLEANOUT IS REQUIRED. WITH THIS BMP, THE MAXIMUM SEDIMENT LEVEL IS WHEN 1 FOOT OF STORAGE IS LOST. PLANS SHOULD CALL OUT THIS ELEVATION FOR MAINTENANCE FOR FUTURE REFERENCE.

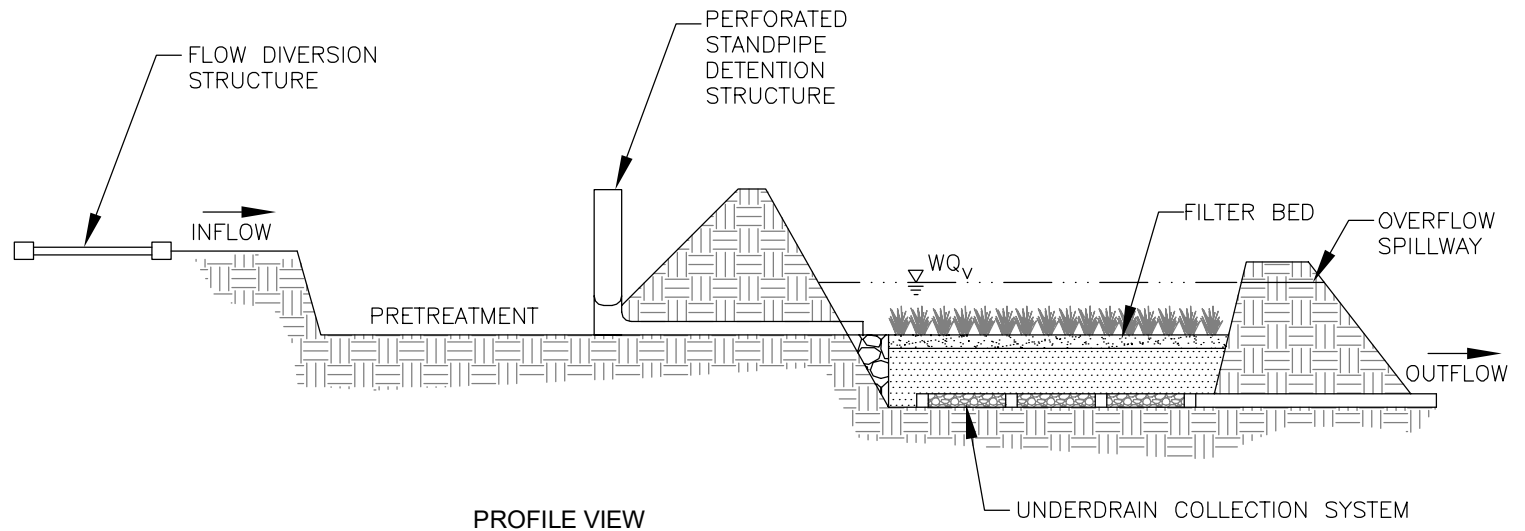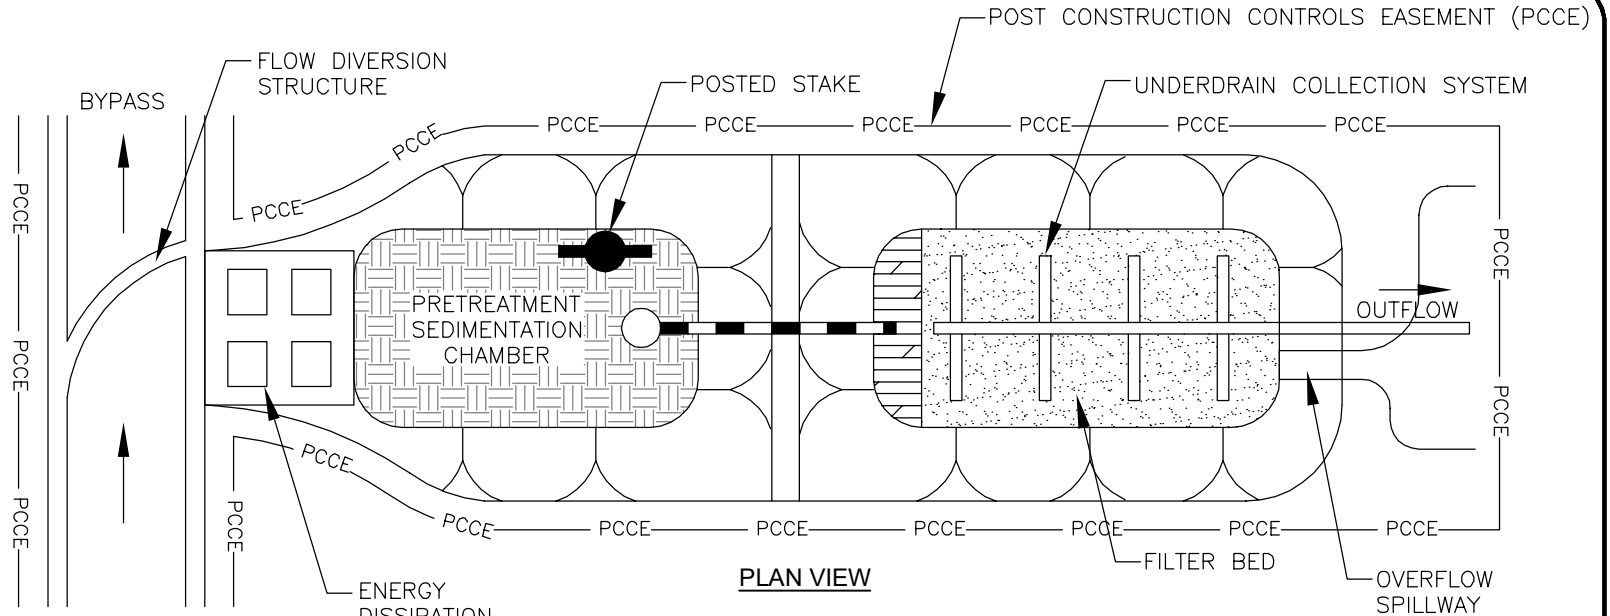

NOT TO SCALE



**TOWN OF PINEVILLE
LAND DEVELOPMENT
STANDARDS**

SURFACE SAND FILTER

REV. DATE	
4/2/21	
STD. NO.	REV.
21.24	5